



FDT181 Heat Detector Product Manual

Overview

The heat detector FDT181 is an intelligent detector. It is used for early fire detection inside a building.

Characteristics

- With built-in CPU, signals received are processed by intelligent algorithm
- Two operation modes: A2S/A2R
- Automatically address setting without encoder setting or DIP switch
- All-around visible alarm indicator
- Resistant to environment and interference factors such as humidity, corrosive and vibration, with immunity against electro-magnetic interference.
- Communication via FD18-BUS, polarity free connection
- “Sticker Method” easy for commissioning

Functions

- The detection behavior of the detectors is influenced by the operation mode, so that it can be specifically adjusted according to the environment to be monitored
- Unique ID of each detector, controller can identify the detector type according to the ID and assign address

Application

- Suitable for use in places where the ambient temperature can change rapidly or smoke detector are not suitable
- Dust cap protects the detector from being contaminated by construction work

Indicator

The detector is provided with an internal alarm indicator to show its operating status.

Status	Indicator
Normal	Off
	Flashing when connected with FC1840-A3 (for Russian).
Locate/Test	Flashing
Alarm	Steady on

Installation


• Easy and time-saving mounting

Install the base and finish the wiring during the construction phase.

1. Point the retaining nest to the positioning pointer and insert it into the base.
2. Turn it clock wisely until it stops.

Uninstallation:


1. Turn it counterclockwisely until it stops.
2. Pull the detector out.

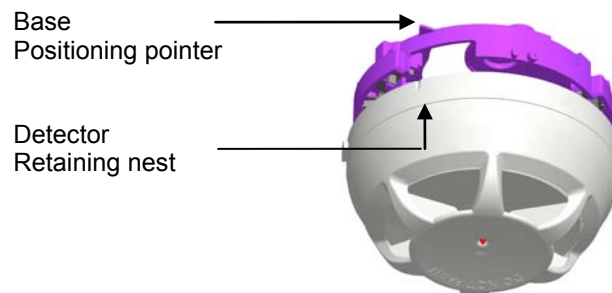


After all the construction is finished, the dust cap must be taken away!

Dimensions

In: mm (with base)

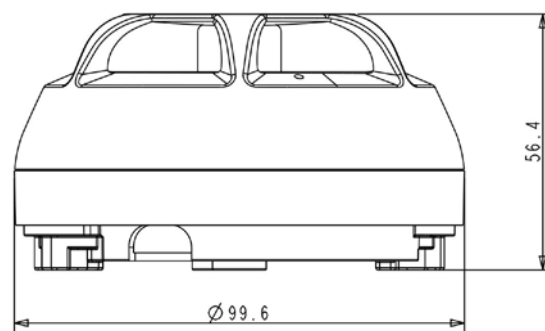

Connection diagram

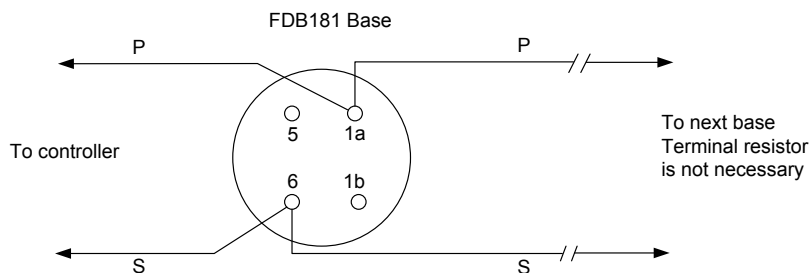

Maintenance

● Performance test

Recommendation:

- Submit all detectors to an annual visual check. Detectors that are strongly soiled or mechanically damaged must be replaced.
- Any detectors should be replaced after 7 to 10 years of service, independent from the environmental conditions.
- Long term auxiliary detectors should be stored with plastic bag.
- Carry out heat test each year.

Technical data

Operating voltage	12 ... 32 VDC
Operating current (quiescent)	0.26 mA
Activation current	1.2 mA
Operating temperature	–10 ... +50 °C
Storage temperature	–20 ... +75 °C
Humidity	≤96% (40±2 °C)
Communication protocol	FD18-BUS
Load factor	1
Color	White, RAL 9010
Protection category EN60529 / IEC529/GB4208-93	IP44
Approval (for Russian)	TR RF N123-FZ

Details for ordering

Type	Material No.	Part No.	Designation	Weight
FDT181	S54320-F3-A1	100856212	Heat detector	0.064Kg
FDB181	S54320-F1-A1	100856213	Detector base	0.027Kg
	A5Q00022001	100566011	FDT181 dust cap	

Beijing Siemens Cerberus Electronics Limited
No.1,Fengzhidonglu, Xibeiwang, HaiDian District,
Beijing, 100094, China
Tel: +10 6476 8806
Fax: +10 6476 8899

© Data and design subject to change without notice.